

MINIMUM 1 1/2" CONDUIT SLEEVE. INSTALL CONDUIT WITH NYLON BUSHINGS & FIRE-BLOCKING (TYP).

CATEGORY 6 UTP

INSTALL 2" J-HOOKS WITH ACCESSORIES 4" SPACING (MAXIMUM), AS REQUIRED


CEILING GRID/HARD CEILING

CEILING GRID/HARD CEILING

1" EMT CONDUIT (TYP).

LIGHT SWITCH – FOR REFERENCE ONLY.

ROOM



SYMBOL PLAN


INSTALL 4"x4"x2" OUTLET BOX WITH SINGLE-GANG FACE PLATE ADAPTER (TYP)

1" EMT CONDUIT (TYP).

10"x8"x4" HOFFMAN BOX FOR FIRE ALERTING SYSTEM PER FLOOR PLANS. CONFIRM BOX ORIENTATION WITH OWNER PRIOR TO INSTALLATION. DEVICES AND WIRING PROVIDED BY OTHERS.

3/4" EMT CONDUIT (TYP).

2. TYPICAL SIZING OF CONDUIT SERVICING OUTLET FROM ACCESSIBLE CEILING SPACE SHALL BE 1" UNLESS NOTED OTHERWISE ON FLOOR PLANS.
3. PROVIDE QUANTITIES AND TYPES OF CABLES PER FLOOR PLANS AND RISER DIAGRAMS.
4. SEE FLOOR PLANS FOR ORIGATION OF CONDUIT SERVICING OUTLET.

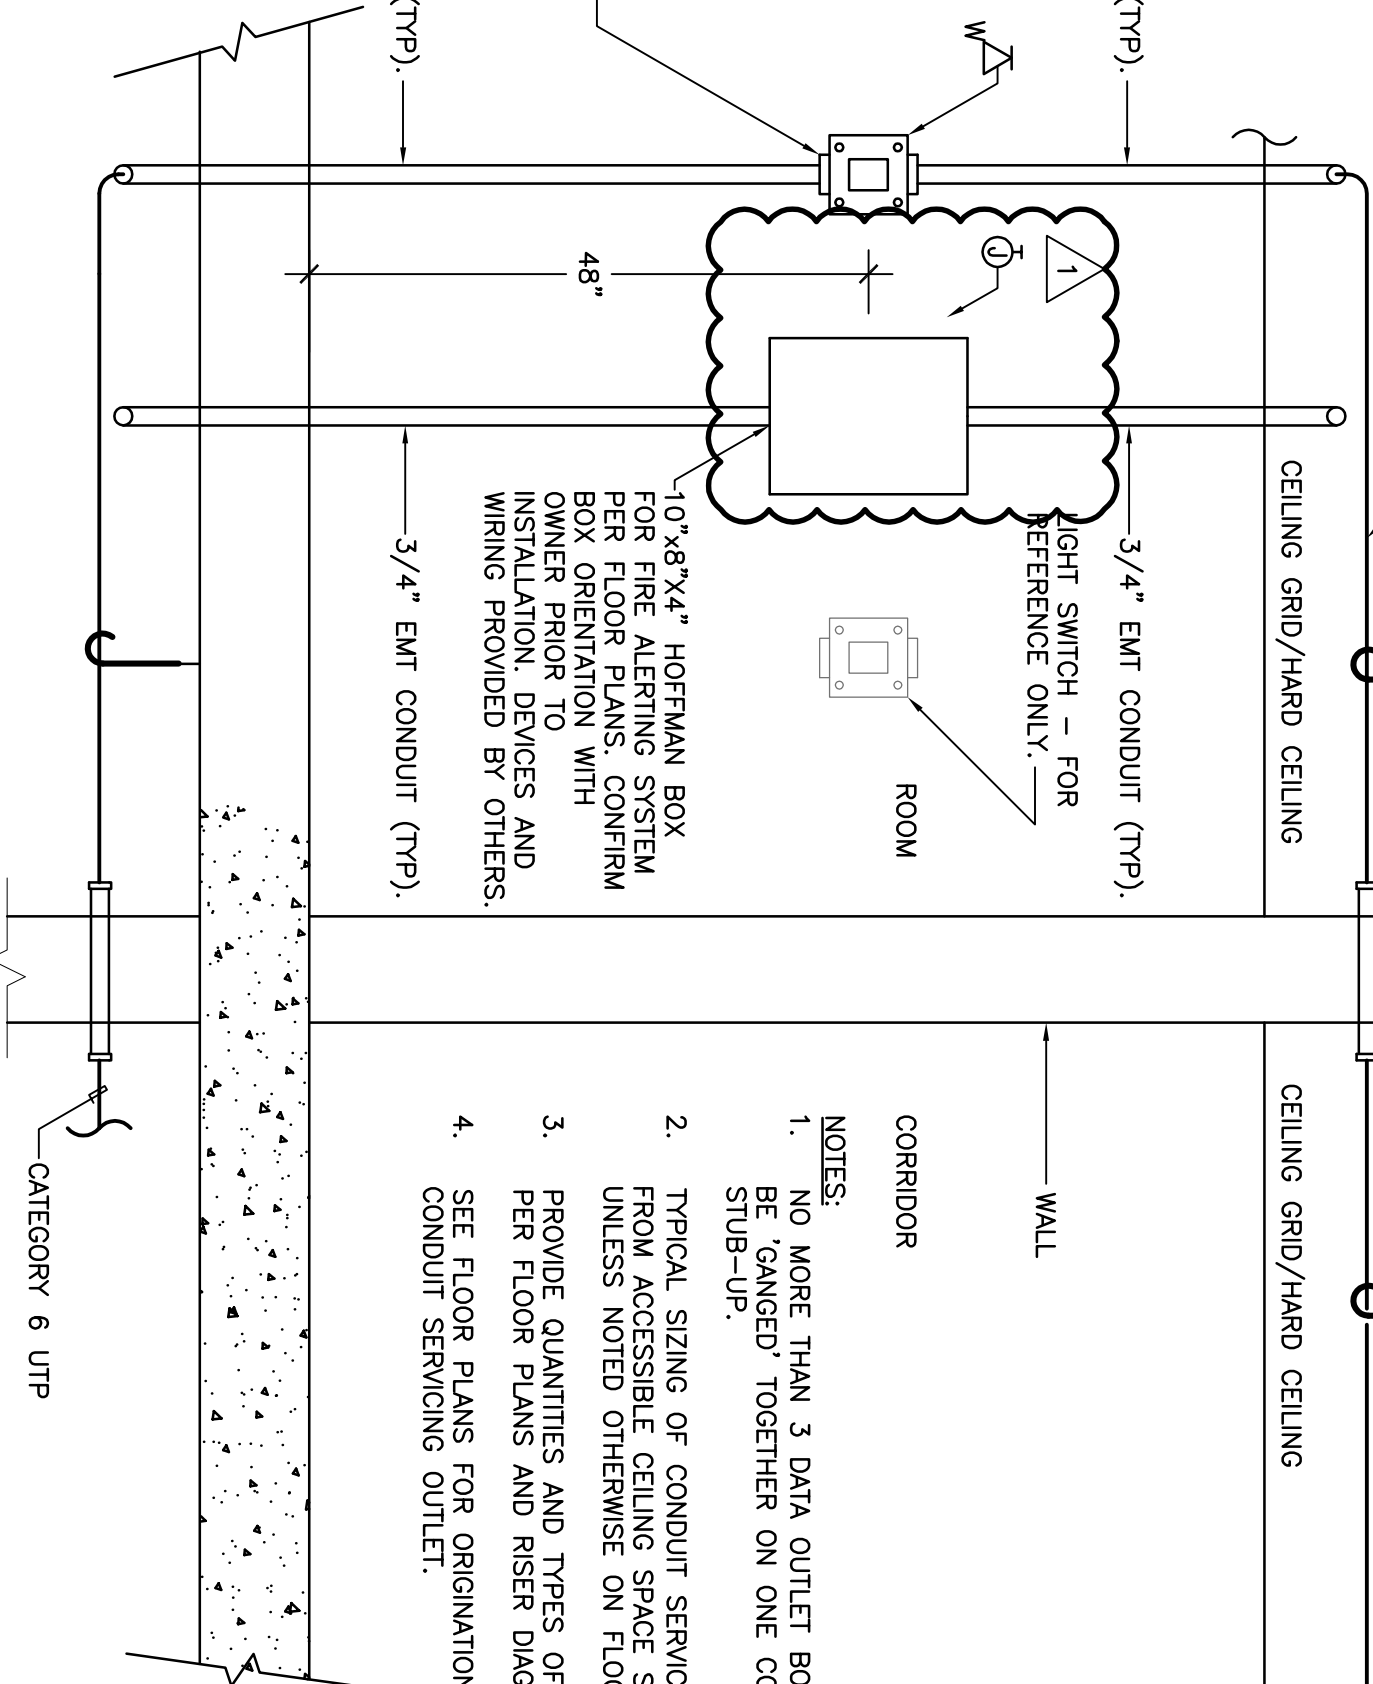

COMMUNICATIONS/FIRE ALERTING WALL OUTLETS TO CORRIDOR/FLOOR BELOW DETAIL (TYP)

DRAWING REFERENCE: T8.2

BRINJAC
ENGINEERING
Since 1955

DRAWN BY: KWW

CHECKED BY: JLS

DATE: 03/21/11

SCALE: AS NOTED

DETAILS - TELECOM

DRAWING NO: TSK-4